
Service Data

Vickers®


## **Flow Controls**

## **Flow Control Valves**

FG-06-\*\*-14

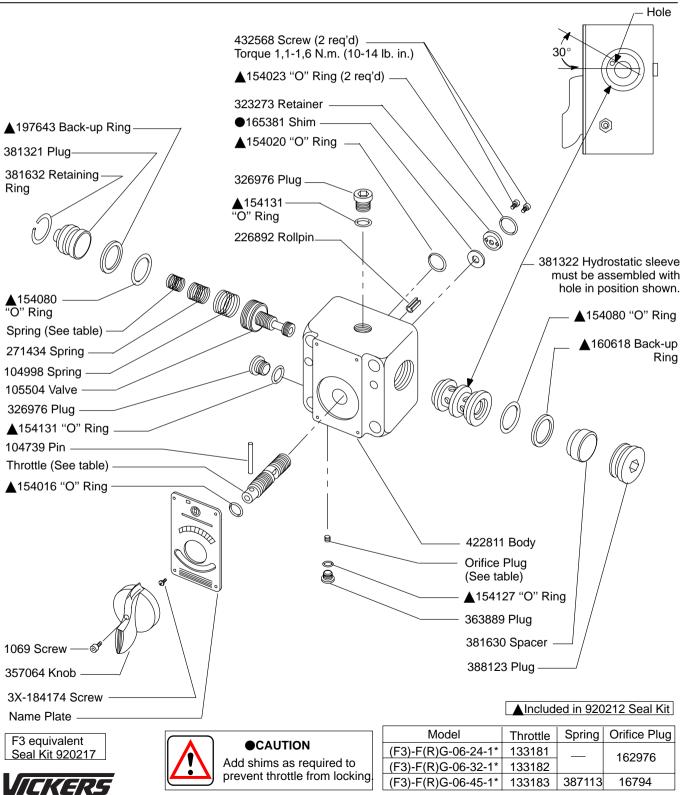



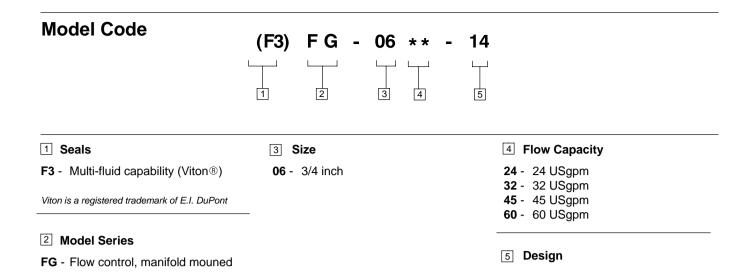

For satisfactory service life of these components, use full flow filtration to provide fluid which meets ISO cleanliness code 18/15 or cleaner. Selections from Eaton OFP,OFR and OFRS filter series are recommended.